

SVENSK STANDARD

SS-EN 13141-4:2011



Fastställt/Approved: 2011-08-01
Publicerad/Published: 2011-08-31
Utgåva/Edition: 2
Språk/Language: engelska/English
ICS: 23.120; 91.140.30

Luftbehandling – Funktionsprovning av komponenter/produkter för bostadsventilation – Del 4: Fläktar för ventilationssystem för bostäder

Ventilation for buildings – Performance testing of components/products for residential ventilation – Part 4: Fans used in residential ventilation systems

This preview is downloaded from www.sis.se. Buy the entire standard via <https://www.sis.se/std-80811>

Standarder får världen att fungera

SIS (Swedish Standards Institute) är en fristående ideell förening med medlemmar från både privat och offentlig sektor. Vi är en del av det europeiska och globala nätverk som utarbetar internationella standarder. Standarder är dokumenterad kunskap utvecklad av framstående aktörer inom industri, näringsliv och samhälle och befrämjar handel över gränser, bidrar till att processer och produkter blir säkrare samt effektiviserar din verksamhet.

Delta och påverka

Som medlem i SIS har du möjlighet att påverka framtida standarder inom ditt område på nationell, europeisk och global nivå. Du får samtidigt tillgång till tidig information om utvecklingen inom din bransch.



Ta del av det färdiga arbetet

Vi erbjuder våra kunder allt som rör standarder och deras tillämpning. Hos oss kan du köpa alla publikationer du behöver – allt från enskilda standarder, tekniska rapporter och standardpaket till handböcker och onlinetjänster. Genom vår webbtjänst e-nav får du tillgång till ett lättnavigerat bibliotek där alla standarder som är aktuella för ditt företag finns tillgängliga. Standarder och handböcker är källor till kunskap. Vi säljer dem.

Utveckla din kompetens och lyckas bättre i ditt arbete

Hos SIS kan du gå öppna eller företagsinterna utbildningar kring innehåll och tillämpning av standarder. Genom vår närhet till den internationella utvecklingen och ISO får du rätt kunskap i rätt tid, direkt från källan. Med vår kunskap om standarders möjligheter hjälper vi våra kunder att skapa verklig nytta och lönsamhet i sina verksamheter.

Vill du veta mer om SIS eller hur standarder kan effektivisera din verksamhet är du välkommen in på www.sis.se eller ta kontakt med oss på tel 08-555 523 00.



Standards make the world go round

SIS (Swedish Standards Institute) is an independent non-profit organisation with members from both the private and public sectors. We are part of the European and global network that draws up international standards. Standards consist of documented knowledge developed by prominent actors within the industry, business world and society. They promote cross-border trade, they help to make processes and products safer and they streamline your organisation.

Take part and have influence

As a member of SIS you will have the possibility to participate in standardization activities on national, European and global level. The membership in SIS will give you the opportunity to influence future standards and gain access to early stage information about developments within your field.

Get to know the finished work

We offer our customers everything in connection with standards and their application. You can purchase all the publications you need from us - everything from individual standards, technical reports and standard packages through to manuals and online services. Our web service e-nav gives you access to an easy-to-navigate library where all standards that are relevant to your company are available. Standards and manuals are sources of knowledge. We sell them.

Increase understanding and improve perception

With SIS you can undergo either shared or in-house training in the content and application of standards. Thanks to our proximity to international development and ISO you receive the right knowledge at the right time, direct from the source. With our knowledge about the potential of standards, we assist our customers in creating tangible benefit and profitability in their organisations.

If you want to know more about SIS, or how standards can streamline your organisation, please visit www.sis.se or contact us on phone +46 (0)8-555 523 00



Europastandarden EN 13141-4:2011 gäller som svensk standard. Detta dokument innehåller den officiella engelska versionen av EN 13141-4:2011.

Denna standard ersätter SS-EN 13141-4:2004, utgåva 1.

The European Standard EN 13141-4:2011 has the status of a Swedish Standard. This document contains the official version of EN 13141-4:2011.

This standard supersedes the Swedish Standard SS-EN 13141-4:2004, edition 1.

© Copyright/Upphovsrätten till denna produkt tillhör SIS, Swedish Standards Institute, Stockholm, Sverige. Användningen av denna produkt regleras av slutanvändarlicensen som återfinns i denna produkt, se standardens sista sidor.

© Copyright SIS, Swedish Standards Institute, Stockholm, Sweden. All rights reserved. The use of this product is governed by the end-user licence for this product. You will find the licence in the end of this document.

Uppllysningar om sakinnehållet i standarden lämnas av SIS, Swedish Standards Institute, telefon 08-555 520 00. Standarder kan beställas hos SIS Förlag AB som även lämnar allmänna uppllysningar om svensk och utländsk standard.

Information about the content of the standard is available from the Swedish Standards Institute (SIS), telephone +46 8 555 520 00. Standards may be ordered from SIS Förlag AB, who can also provide general information about Swedish and foreign standards.

Denna standard är framtagen av kommittén för Luftbehandlingsteknik, SIS/TK 170.

Har du synpunkter på innehållet i den här standarden, vill du delta i ett kommande revideringsarbete eller vara med och ta fram andra standarder inom området? Gå in på www.sis.se - där hittar du mer information.

EUROPEAN STANDARD

EN 13141-4

NORME EUROPÉENNE

EUROPÄISCHE NORM

July 2011

ICS 91.140.30

Supersedes EN 13141-4:2004

English Version

Ventilation for buildings - Performance testing of
components/products for residential ventilation - Part 4: Fans
used in residential ventilation systems

Ventilation des bâtiments - Essais de performance des
composants/produits pour la ventilation des logements -
Partie 4: Ventilateurs utilisés dans les systèmes de
ventilation des logements

Lüftung von Gebäuden - Leistungsprüfungen von
Bauteilen/Produkten für die Lüftung von Wohnungen - Teil
4: Ventilatoren in Lüftungsanlagen für Wohnungen

This European Standard was approved by CEN on 4 June 2011.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN-CENELEC Management Centre or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland and United Kingdom.



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG

Management Centre: Avenue Marnix 17, B-1000 Brussels

Contents

Page

Foreword.....	3
1 Scope	6
2 Normative references	6
3 Terms and definitions	6
4 Performance testing of aerodynamic characteristics.....	7
4.1 General.....	7
4.2 Test Installation and conditions.....	8
4.2.1 General.....	8
4.2.2 Exhaust fan units mounted in a casing.....	8
4.2.3 Roof exhaust fans.....	11
4.3 Test procedure	11
4.4 Energy efficiency	11
4.5 Presentation of results.....	15
5 Performance testing of acoustic characteristics	15
5.1 General.....	15
5.2 Test Installation and conditions.....	15
5.2.1 Parameters to test and test method.....	15
5.2.2 In-duct method.....	16
5.2.3 Reverberant room method.....	17
5.2.4 Enveloping surface method.....	18
5.3 Test procedure	18
5.4 Presentation of results.....	19
6 Performance testing of electrical power	19
6.1 Testing method	19
6.2 Presentation of results.....	19
7 Safety	20
Bibliography.....	21

Foreword

This document (EN 13141-4:2011) has been prepared by Technical Committee CEN/TC 156 “Ventilation for buildings”, the secretariat of which is held by BSI.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by January 2012, and conflicting national standards shall be withdrawn at the latest by January 2012.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CEN [and/or CENELEC] shall not be held responsible for identifying any or all such patent rights.

This document supersedes EN 13141-4:2004.

In comparison to EN 13141-4:2004, the following changes have been made:

- in Clause 2 updating of the normative references mainly to include the revision of acoustics standards;
- in Clause 3 updating of the definitions;
- in 4.2.2.1 Figures 2 and 3 have been defined more precisely and an example of connection box for inlets on 2 opposite faces of the fan casing has been added in Figure 3 c);
- in 4.2.2.2 b) suppression of the procedure to determine the inlet to be connected;
- in 4.3 suppression of the equation to calculate the fan work per unit mass;
- addition of 4.4 Energy efficiency including Table 2 concerning part load weighting and an equation to calculate the weighted energy efficiency;
- in 5.1 change of terms;
- addition of 5.2.1 Parameters to test and test method including Table 3 concerning tests methods;
- in 5.2.3 (ex 5.2.2) suppression of the note and adding of an example of test room for category D installation in Figure 9 d);
- in 5.2.4 (ex 5.2.3) suppression of the list of standards and the sentence concerning non-ideal free field conditions;
- in 5.4 modification of the limits of the octave band for the presentation of results, addition of the list of the results that shall be specify and modification of the Table 4 (ex Table 1);
- 6.1 the points of measurement have been defined more precisely;
- in Bibliography updating of the references.

The standard is one of a series of standards on residential ventilation. The performance characteristics of the components/products for residential ventilation are given in EN 13142.

The position of this standard in the field of mechanical building services is shown in Figure 1.

According to the CEN/CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland and the United Kingdom.

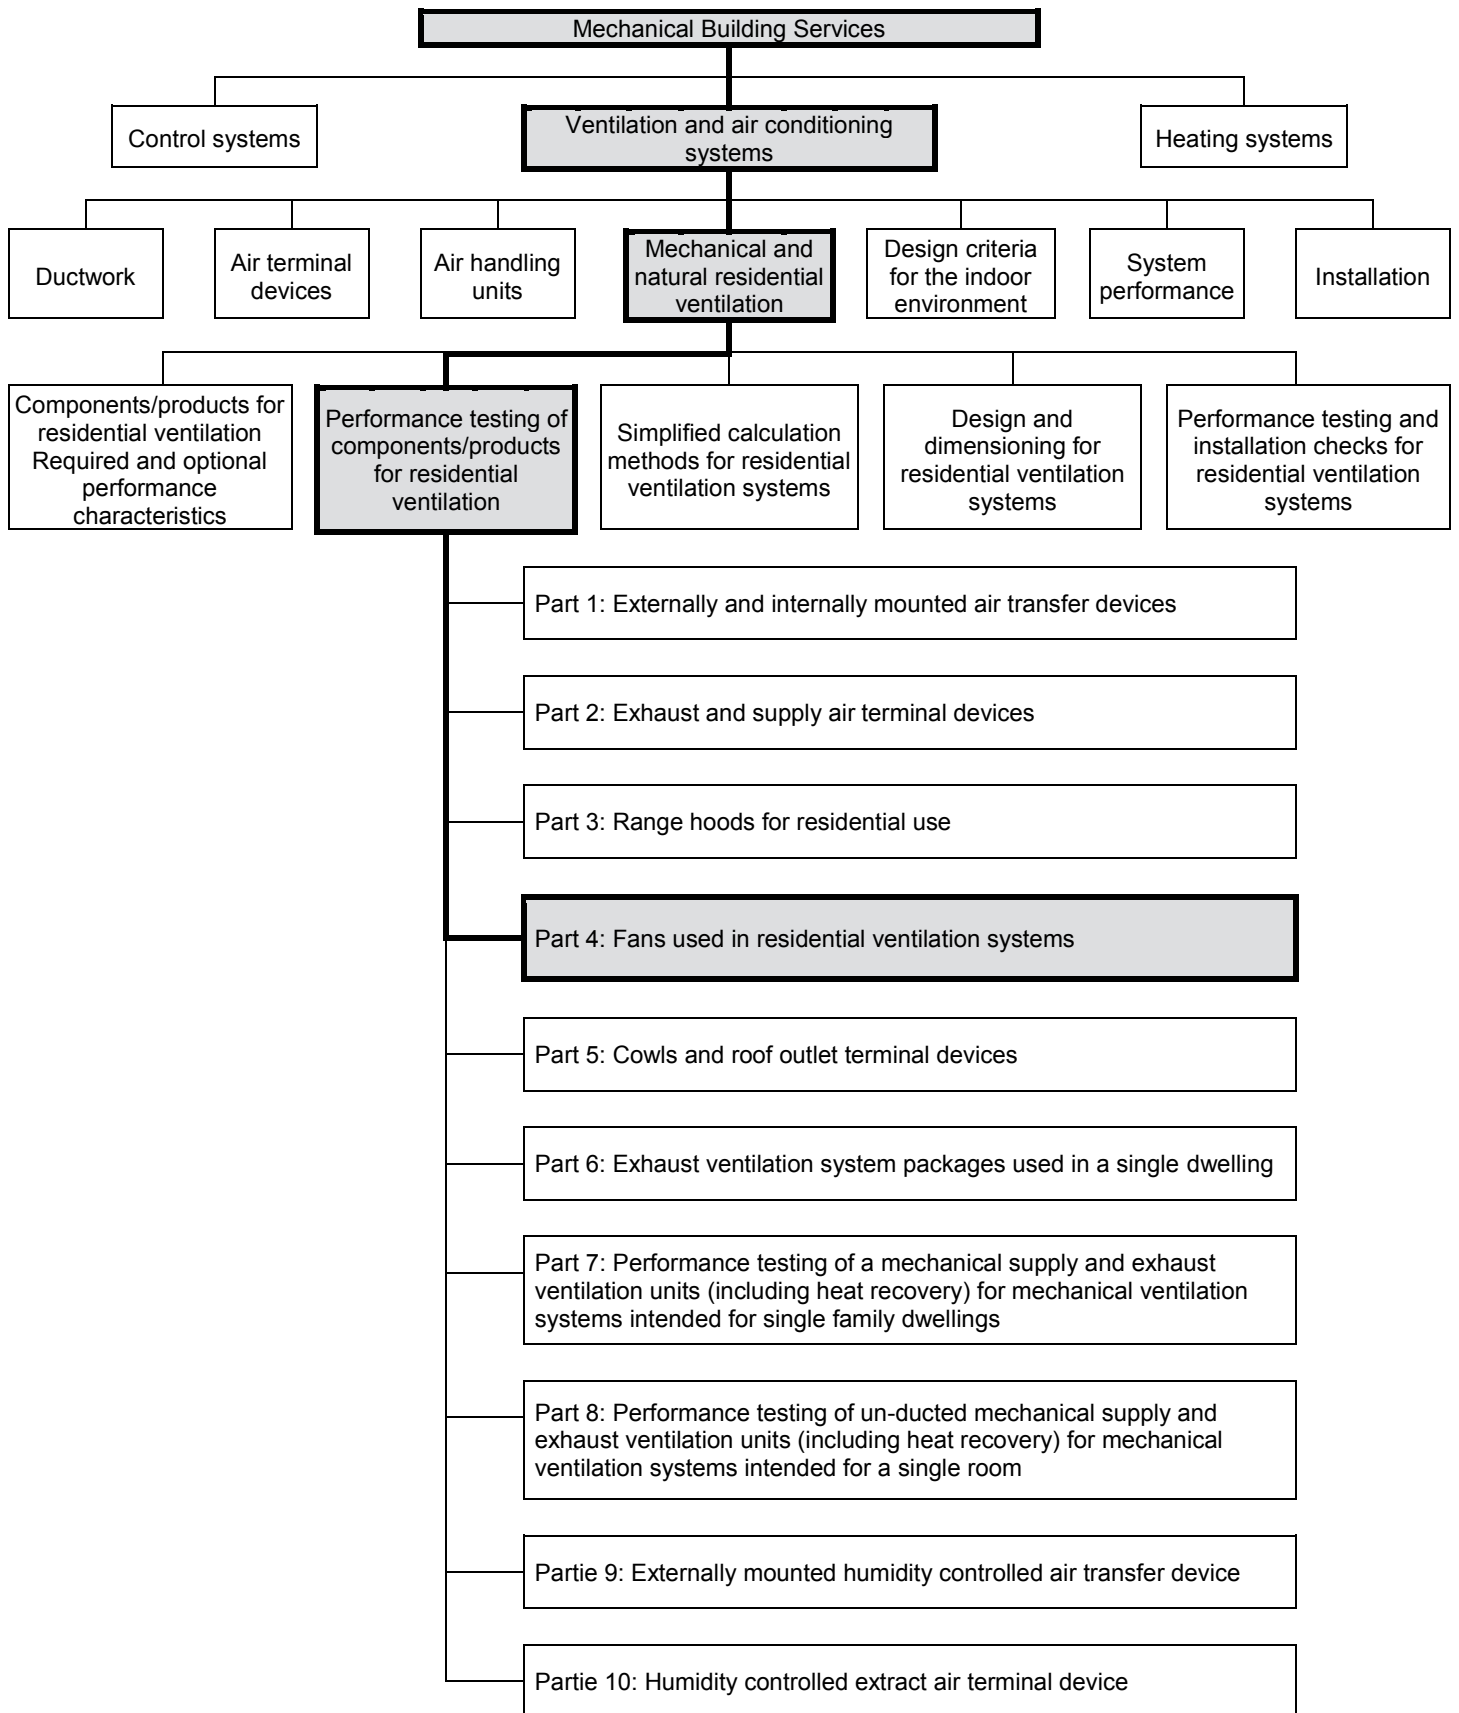


Figure 1 — Position of EN 13141-4 in the field of mechanical building services

1 Scope

This European Standard specifies aerodynamic, acoustic and electrical power performance test methods for fans used in residential ventilation. These methods primarily concern:

- ventilation fans installed on a wall or in a window without any duct;
- ventilation fans installed in the downstream of a duct;
- ventilation fans installed in the upstream of a duct;
- ventilation fans installed in a duct;
- encased ventilation fans having several inlets.

For acoustic performance testing one of the following methods is used:

- in-duct method;
- reverberant room method;
- enveloping surface method.

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 60335-2-80, *Household and similar electrical appliances — Safety — Part 2-80: Particular requirements for fans (IEC 60335-2-80:2002)*

EN ISO 5136 *Acoustics — Determination of sound power radiated into a duct by fans and other air-moving devices — In-duct method (ISO 5136:2003)*

EN ISO 5801:2008, *Industrial fans — Performance testing using standardized airways (ISO 5801:2007 including Cor 1:2008)*

ISO 13347-2, *Industrial fans — Determination of fan sound power levels under standardized laboratory conditions — Part 2: Reverberant room method*

ISO 13347-3, *Industrial fans — Determination of fan sound power levels under standardized laboratory conditions — Part 3: Enveloping surface methods*

3 Terms and definitions

For the purpose of this document, the terms and definitions given in EN ISO 5801:2008 and the following apply.

3.1 fan pressure

p_F
pressure increase (in Pa) induced by the fan given as the difference of outlet and inlet total pressure

NOTE Pressure is expressed in Pascals.

3.2**fan unit**

casing incorporating a fan and provided with spigots

3.3**test-voltage**

voltage to be used for supplying the fan during the testing (in V)

NOTE Test voltage is expressed in Volts.

3.4**declared maximum air volume flow**

$Q_{vmax,d}$

maximum air volume flow corresponding to the operating range declared by the manufacturer, given for standard air conditions (20 °C, 101 325 Pa) (in m³/s)

NOTE 1 The declared maximum air volume flow is expressed in m³/s.

NOTE 2 $Q_{vmax,d}$ is not the end point of the curve but a point declared by the manufacturer and ideally chosen for a pressure taken in the list of p_{ref} .

3.5**reference total pressure**

p_{ref}

pressure set in the table of reference (see Table 1), equal or just below the pressure obtained for declared maximal air volume flow, given in total pressure (in Pa)

Table 1 — Set of reference fan total pressure p_{ref}

Total reference pressure						
p_{ref}						
Pa						
10	20	50	100	150	200	250

NOTE If the measured pressure is lower than 10 Pa, use 10 Pa.

3.6**reference air volume flow**

q_{vref}

air volume flow measured during the aerodynamic test of the envelope curve (maximum setting) and corresponding to the total pressure, given for standard air conditions (20 °C, 101 325 Pa) (in m³/s)

NOTE The reference air volume flow is expressed in m³/s.

3.7**Demand Controlled Ventilation****DCV**

method providing automatic regulation to the ventilation system dependant upon the needs of air change rates (occupancy, pollution loads, etc.) using a suitable sensor and without user intervention i.e. automatic

4 Performance testing of aerodynamic characteristics**4.1 General**

The test shall be carried out in accordance with EN ISO 5801 and with 4.2 to 4.4.